COMECO
Measurement, control, calibration

Colors and connection of wires to Pt sensor according to IEC 60751

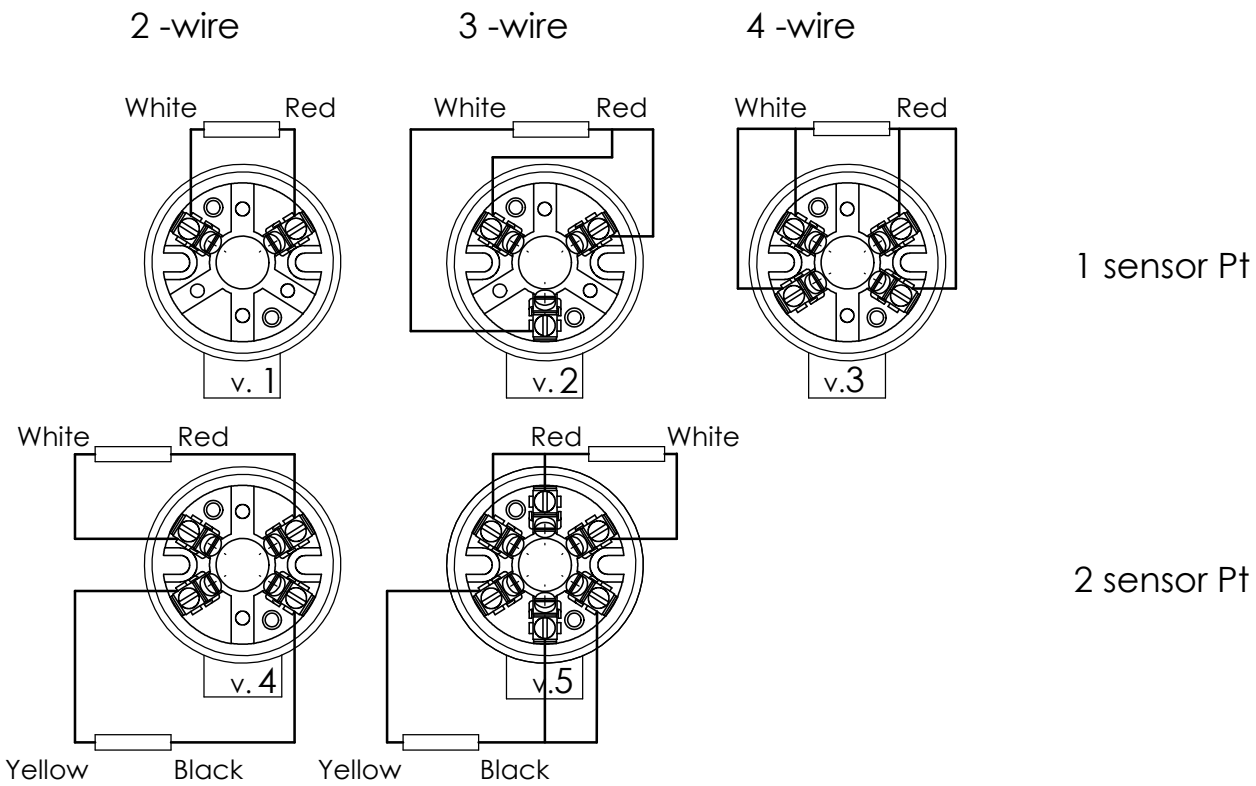

*In case the wires are of different color to the indicated above, refer to the markings on the terminals instead.

*It is possible for the terminals to be positioned differently than shown in v.1 and v.2.